


20 INPUTS 20 OUTPUTS WITH IP PORT

Product Diagrams V 1.1

Model: RCU-20R20Z-IP





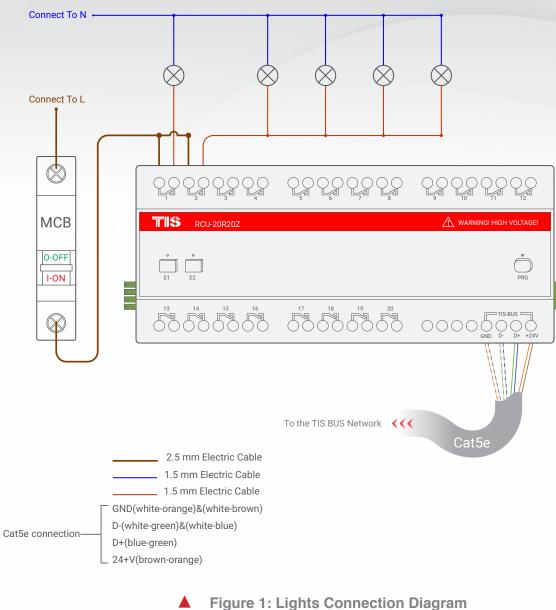



20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



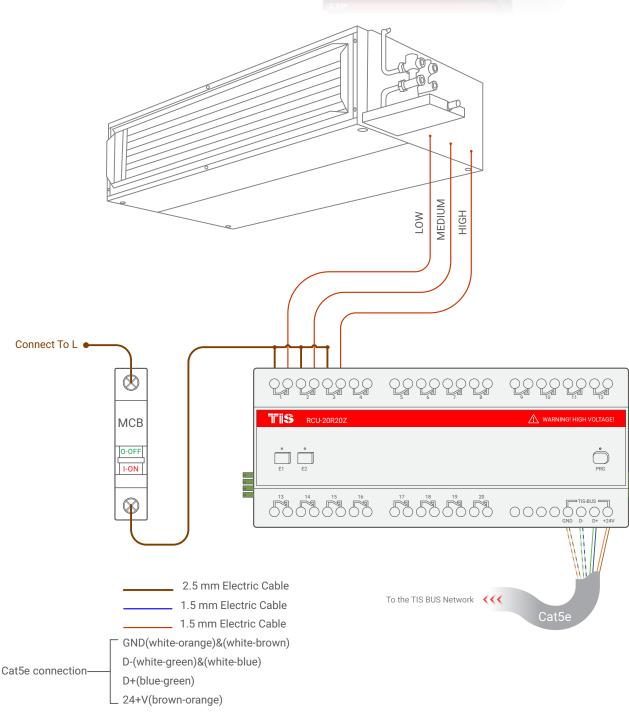


Figure 2: FCU Connection Diagram




TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

SUITE# 610. 860 NORTH DOROTHY DR RICHARDSON TX 75081.USA

RM 1502-p9 Easey CommBldg 253-261 Hennessy Rd Wanchai Hong Kong

20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



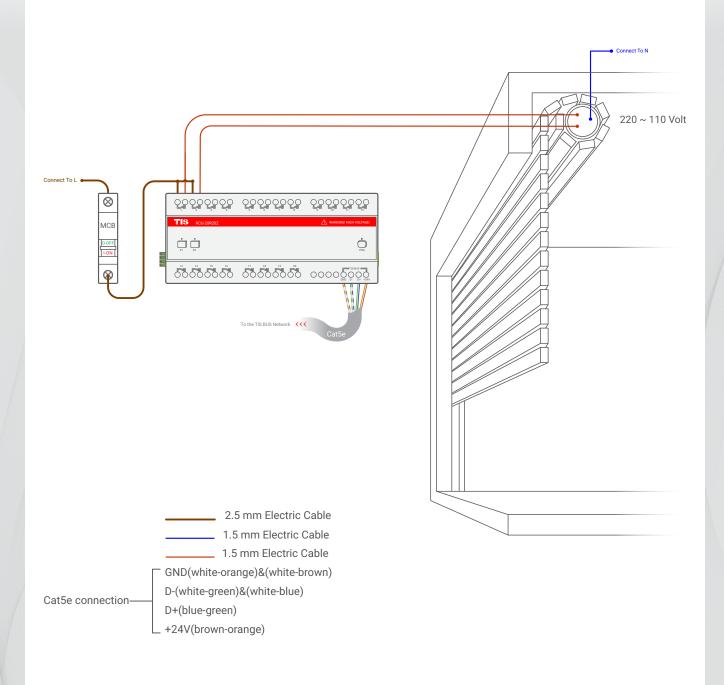



TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

SUITE# 610. 860 NORTH DOROTHY DR RICHARDSON TX 75081.USA

RM 1502-p9 Easey CommBldg 253-261 Hennessy Rd Wanchai Hong Kong


Figure 3: Motors Connection Diagram



20 INPUTS 20 OUTPUTS WITH IP PORT

Model: RCU-20R20Z-IP



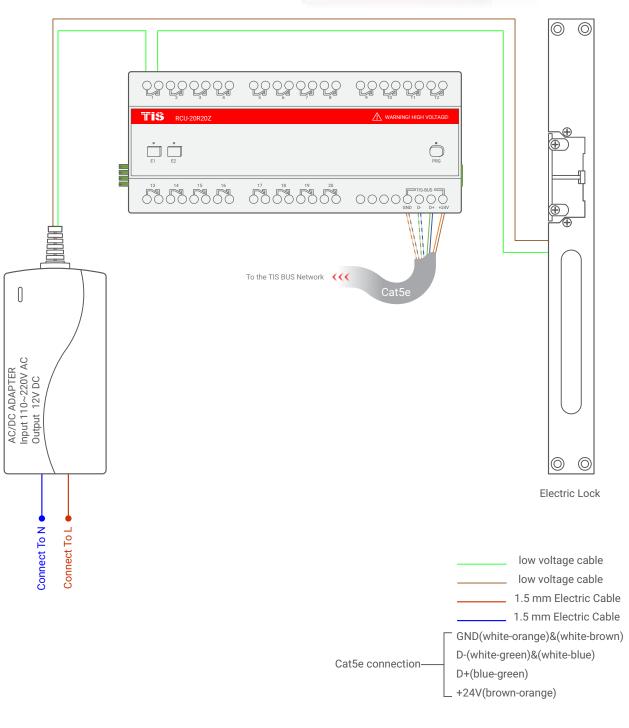





TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

SUITE# 610. 860 NORTH DOROTHY DR RICHARDSON TX 75081.USA

RM 1502-p9 Easey CommBldg 253-261 Hennessy Rd Wanchai Hong Kong

20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



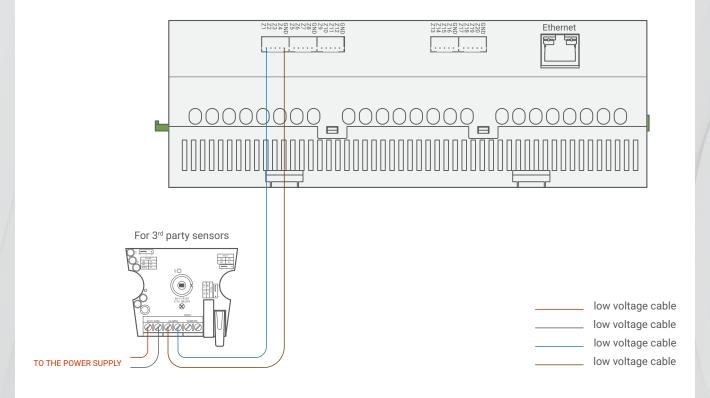



Figure 5: 3rd Party Sensor Connection Diagram



20 INPUTS 20 OUTPUTS WITH IP PORT

Model: RCU-20R20Z-IP



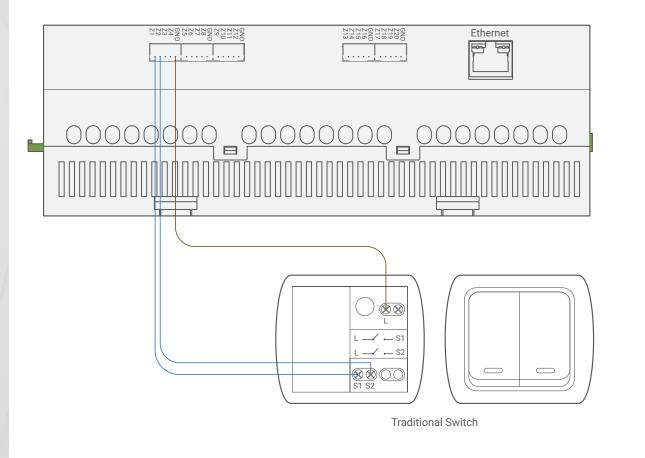

low voltage cable low voltage cable


Figure 6: Traditional Light Switch Connection Diagram





20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



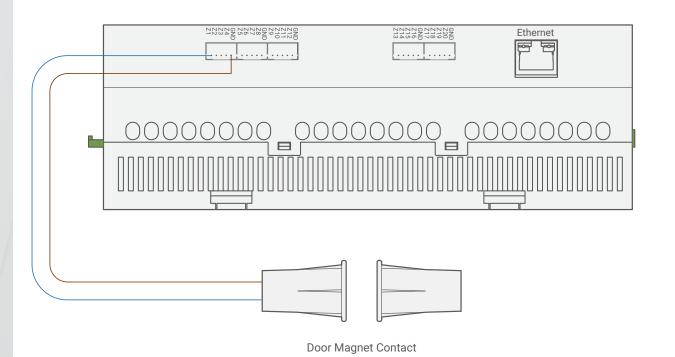

low voltage cable low voltage cable

Figure 7: Magnetic Door Contact Connection Diagram





20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



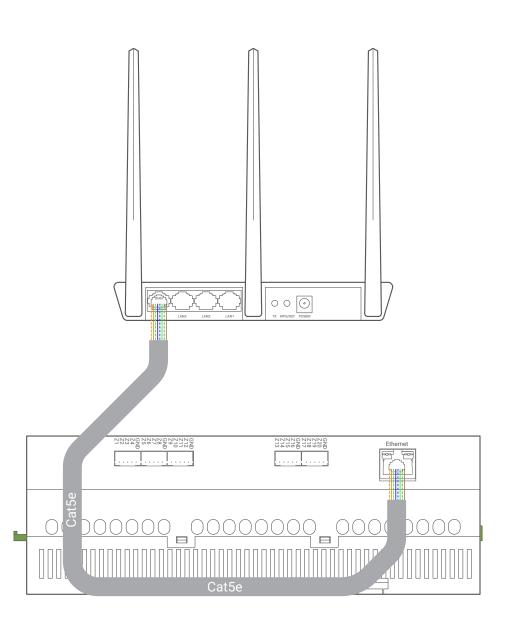


Figure 8: Ethernet Router Connection Diagram




RICHARDSON TX 75081.USA



20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



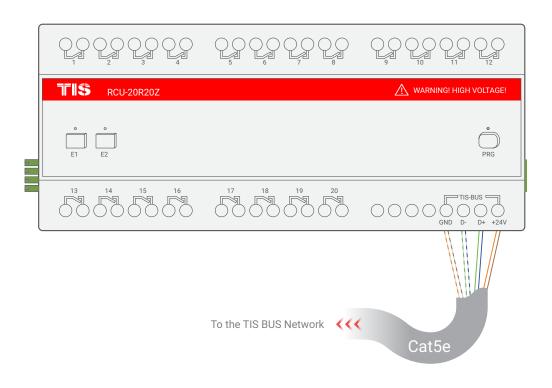




Figure 9: Module's Bus Connection Color Coding



Copyright © 2020 TIS, All Rights Reserved

TIS Logo is a Registered Trademark of Texas Intelligent System LLC in the United States of America. This company takes TIS Control Ltd. in other countries. All of the Specifications are subject to change without notice.

EXAS INTELLIGENT SYSTEM LLC

SUITE# 610. 860 NORTH DOROTHY DR RICHARDSON TX 75081.USA TIS CONTROL LIMITED

RM 1502-p9 Easey CommBldg 253-261 Hennessy Rd Wanchai Hong Kong



20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



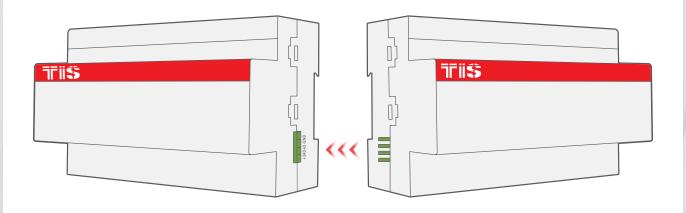



Figure 10: DIN-Rail Bus Module Configuration Diagram





20 INPUTS 20 OUTPUTS WITH IP PORT Model: RCU-20R20Z-IP



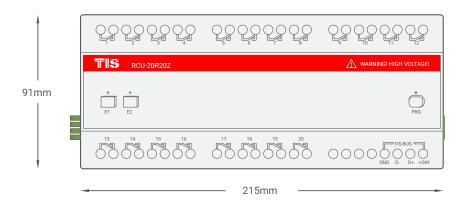




Figure 11: Module's Dimension Diagram



RICHARDSON TX 75081.USA